



Regulatory Investment Test for Distribution (RIT-D)

Addressing Reliability Requirements in the LDM Network Area

Draft Project Assessment Report

16 November 2022

Addressing Reliability Requirements in the LDM Network Area

Draft Project Assessment Report

EXECUTIVE SUMMARY

About Energex

Energex Limited (Energex) is a subsidiary of Energy Queensland Limited and manages the electricity distribution network in the growing region of South East Queensland which includes the major urban areas of Brisbane, Gold Coast, Sunshine Coast, Logan, Ipswich, Redlands and Moreton Bay. Our electricity distribution area runs from the NSW border north to Gympie and west to the base of the Great Dividing Range.

Our electricity network consists of approximately 54,200 kilometres of powerlines and 680,000 power poles, along with associated infrastructure such as major substations and power transformers.

Today, we provide distribution services to more than 1.4 million domestic and business connections, delivering electricity to a population base of around 3.4 million people.

Identified Need

Lindum Zone Substation (SSLDM) is a 33kV switching station linking 110/33kV bulk supply substations SSLBS (Lytton Bulk Supply), and SSDBS (Doboy Bulk Supply). SSLBS is radially fed by 2 x (110kV) feeders, on the same towers, from Powerlink's H21 Murrarie substation. SSLBS 33kV system feeds a total 22,700 customers (21,229 residential and 1,471 business), with a residential consumption of 115.03 GWh and business consumption of 435.21 GWh. Several 33kV/11kV Zone Substations are fed by SSLBS, which include: SSGIS (Gibson Island), SSLYT (Lytton), SSFIS (Fishermans Island), SSFBS (Fishermans Bulk Supply), SSWYN (Wynnum), SSLBS (Lytton Bulk Supply), SSLTA (LTA). There are large industrial customers supplied from the 33kV network of SSLBS including, one with a maximum demand of 24.8MVA and energy consumption of 147GWh per annum, another with a maximum demand of 19.2MVA and energy consumption of 128GWh per annum and a third with a maximum demand of 11.2MVA and energy consumption of 48.1GWh per annum. SSLDM provides an alternate supply for SSLBS.

Based on a Condition Based Risk Management (CBRM) analysis, the following have been deemed to reach their retirement age at SSLDM:

- 8 x 33kV Circuit Breakers: CB3X12, CB3X22, CB5992, CB6002, CB6812, CB6822, CB6872 and CB6882 by 2023
- 36 concrete busbar supports
- 13 electronic protection relays

Approach

The National Electricity Rules (NER) require that, subject to certain exclusion criteria, network business investments for meeting service standards for a distribution business are subject to a Regulatory Investment Test for Distribution (RIT-D). Energex has determined that network investment is essential in this case for it to continue to provide electricity to the consumers and

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

generators in the SSLBS supply area in a reliable, safe, and cost-effective manner. Accordingly, this investment is subject to a RIT-D.

Energex published a Non-Network Options Report for the network constraint on 11 November 2022.

Given the requirement for backup supply to SSLBS and connection of a large generator, only one feasible option has been investigated:

- Option A: Replace Outdoor CBs and Maintain SSLDM

This Draft Project Assessment Report (DPAR), where Energex provides both technical and economic information about possible solutions, has been prepared in accordance with the requirements of clause 5.17.4(i) of the NER.

Energex's preferred solution to address the identified need is Option A – Replace Outdoor CBs and Maintain SSLDM

The DPAR seeks information from interested parties about possible alternate solutions to address the need for investment.

Submissions in writing are due on the **28 December 2022** by 4pm and must be lodged to demandmanagement@energex.com.au

For further information and inquiries please contact:

E: demandmanagement@energex.com.au

P: 13 74 66

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

CONTENTS

Executive Summary	2
About Energex.....	2
Identified Need	2
Approach	2
1. Introduction	6
1.1. Structure of the Report.....	6
1.2. Contact Details.....	6
2. Background.....	7
2.1. Geographic Region	7
2.2. Existing Supply System	11
2.3. Load Profiles / Forecasts	13
2.3.1. Full Annual Load Profile	13
2.3.2. Load Duration Curve	14
2.3.3. Average Peak Weekday Load Profile (Summer)	15
2.3.4. Base Case Load Forecast.....	17
2.3.5. High Growth Load Forecast	18
2.3.6. Low Growth Load Forecast	19
3. Identified Need	20
3.1. Description of the Identified Need.....	20
3.1.1. Aged and Poor Condition Assets	20
3.1.2. Reliability	20
3.1.3. Safety Net Non-Compliance.....	20
3.2. Quantification of the Identified Need.....	21
3.2.1. Aged and Poor Condition Assets	21
3.2.2. Safety Net Non-Compliance.....	21
3.2.3. Risk Quantification Benefit Summary	22
3.3. Assumptions in Relation to Identified Need	22
3.3.1. Forecast Maximum Demand.....	22
3.3.2. Load Profile	23
4. Credible Options Assessed	24
4.1. Assessment of Network Solutions	24
4.1.1. Option A: Replace Outdoor CBs and Maintain SSLDM.....	24

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

4.2.	Preferred Network Option	25
5.	Market Benefit Assessment Methodology.....	27
5.1.	Classes of Market Benefits not Expected to be Material	27
5.1.1.	Changes in Voluntary Load Curtailment	27
5.1.2.	Changes in Costs to Other Parties.....	27
5.1.3.	Changes in Timing of Expenditure	27
5.1.4.	Changes in Load Transfer Capability.....	28
5.1.5.	Changes in Network Losses	28
5.1.6.	Option Value.....	28
6.	Detailed Economic Assessment	28
6.1.	Methodology.....	28
6.2.	Key Variables and Assumptions	28
6.3.	Net Present Value (NPV) Results	29
6.4.	Selection of Preferred Option.....	29
6.5.	Satisfaction of RIT-D.....	29
7.	Submission and Next Steps	30
7.1.	Submissions from Solution Providers	30
7.2.	Next Steps.....	30
8.	Compliance Statement	31
	Appendix A – The Rit-D Process.....	33

Addressing Reliability Requirements in the LDM Network Area

Draft Project Assessment Report

1. INTRODUCTION

This Draft Project Assessment Report has been prepared by Energex in accordance with the requirements of clause 5.17.4(i) of the NER.

This report represents the second stage of the consultation process in relation to the application of the RIT-D on the potential credible option to address the identified need for the SSLDM network area.

In preparing this RIT-D, Energex is required to consider reasonable future scenarios. With respect to major customer loads and generation, Energex has, in good faith, included as much detail as possible while maintaining necessary customer confidentiality. Potential large future connections that Energex is aware of are in different stages of progress and are subject to change (including outcomes where none or all proceed). These and other customer activity can occur over the consultation period and may change the timing and/or scope of any proposed solutions.

1.1. Structure of the Report

This report:

- Provides background information on the network capability limitations of the distribution network supplying the LDM area.
- Identifies the need which Energex is seeking to address, together with the assumptions used in identifying and quantifying that need.
- Describes the credible option that is considered in this RIT-D assessment.
- Quantifies costs and classes of material market benefits for the credible option.
- Describes the methods used in quantifying each class of market benefit.
- Provides details of classes of market benefits that are not considered material to this RIT-D assessment and provides explanations as to why these classes of market benefits are not considered material.
- Provides the results of Net Present Value (NPV) analysis of the credible option and accompanying explanatory statements regarding the results.
- Identifies the proposed preferred option, including detailed characteristics, estimated commissioning date, indicative costs, and noting that it satisfies the RIT-D.
- Provides contact details for queries on this RIT-D.
- Is an invitation to registered participants and interested parties to make submissions.

1.2. Contact Details

Submissions in writing are due by 4pm on **27 December 2022** and should be lodged to demandmanagement@energex.com.au.

For further information and inquiries please contact:

E: demandmanagement@energex.com.au

P: 13 74 66

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

2. BACKGROUND

2.1. Geographic Region

Lindum substation (SSLDM) is a 33kV switching station providing alternate 33kV supply to SSLBS (Lytton Bulk Supply Substation). SSLBS supply area is predominately industrial supply with several major industrial customers. LBS supplies 7 x 33/11/kV zone substations (GIS Gibson Island, LYT Lytton, FIS Fishermans Island, FBS Fishermans Island Bulk, WNM Wynnum, LTA Lota, LBS Lytton Bulk Supply) providing electricity supply to approximately 22,700 customers, of which 94% are residential and 6% are commercial, and industrial. Total energy supplied by LBS is 550.24 GWh of which 79% is used by in commercial and industrial processes and 21% by residential customers.

LBS is radially fed by 2 x 110kV power lines on the same tower coming from Powerlink's H21 Substation, Murrarie. SSLDM provides a necessary backup supply to SSLDM for a credible contingency event.

The geographical location of Energex's 110kV network and substations in the area is shown in Figure 1 and Figure 2 provides a schematic view. LDM 33kV feeder geographic view is shown in Figure 3.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report



Figure 1: Existing network arrangement (geographic view)

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

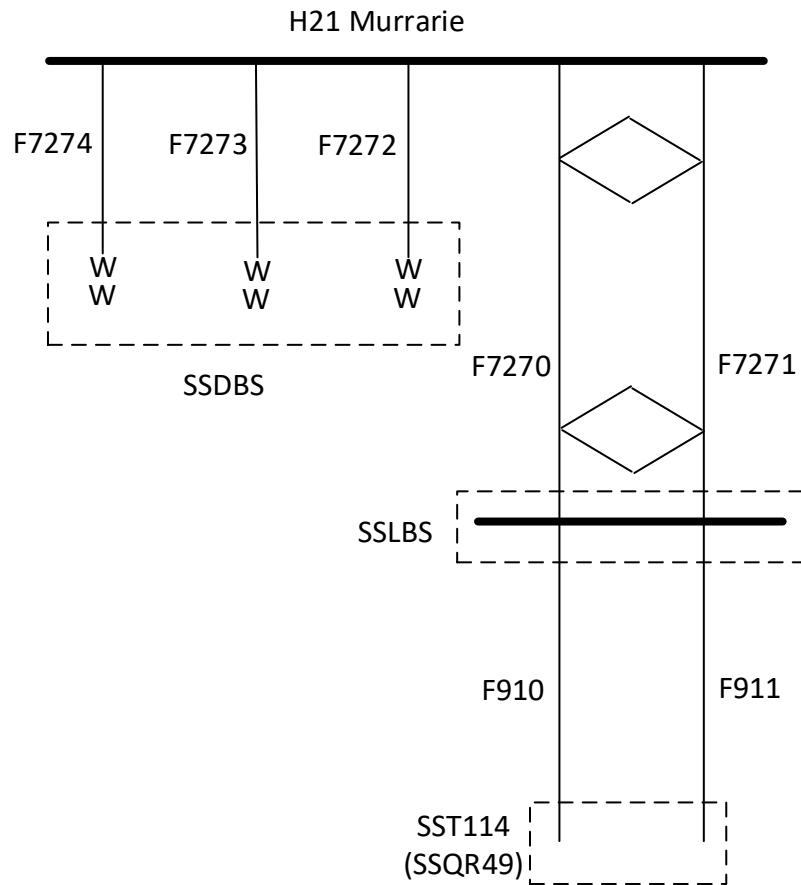


Figure 2: Existing 110kV network arrangement (Schematic)

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

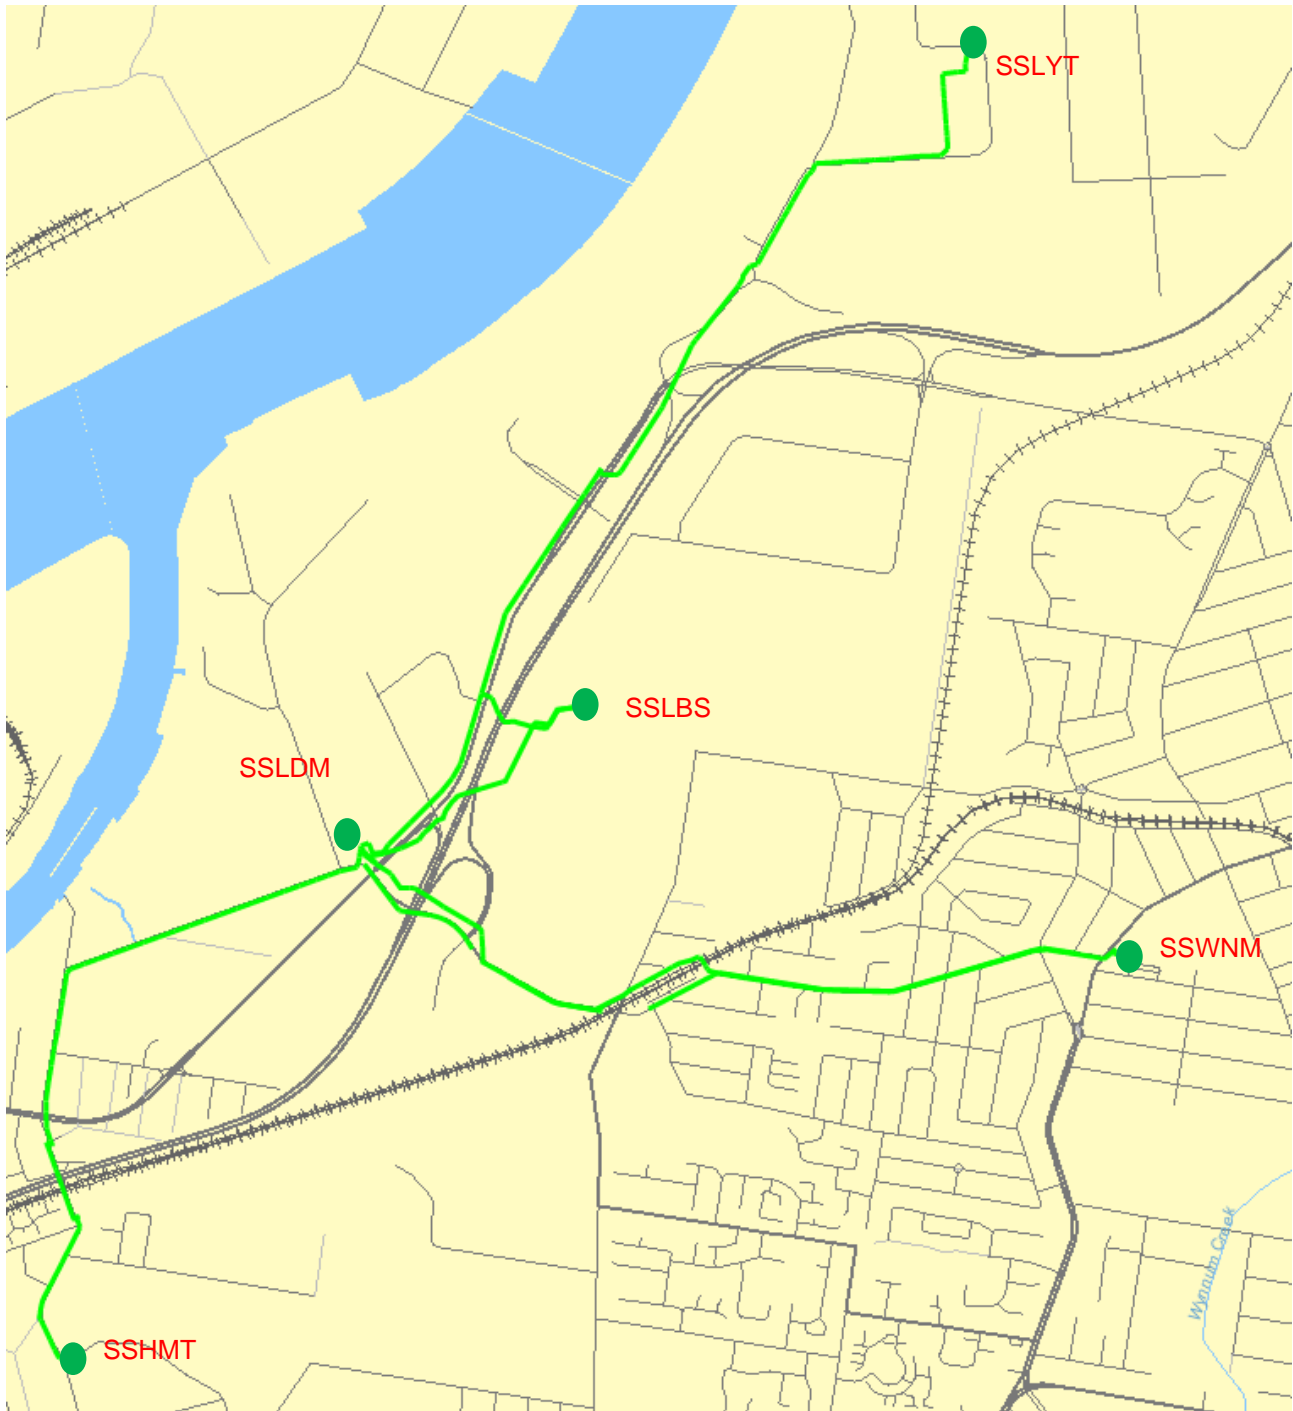


Figure 3: Existing 33kV network arrangement LDM (geographic view)

Addressing Reliability Requirements in the LDM Network Area

Draft Project Assessment Report

2.2. Existing Supply System

Lindum 33kV Switching Substation (SSLDM) is located approximately 2.7 km NE from H21 Murrarie and approximately 800m SW of LBS Lytton Bulk Supply beside the Port of Brisbane Motorway. The substation is part of the LBS / DBS 33kV sub-transmission network and aides in providing supply to Lytton Bulk Supply 110/33kV Bulk Supply Substation (LBS) for total loss of 110kV supply to SSLBS. Lindum Substation is presently supplied via two incoming 33kV feeders from LBS Lytton Bulk Substation, and there are two outgoing 33kV feeders from Lindum Substation which provide supply to Wynnum 33/11kV Substation (WNM), there is a 33kV feeder CB which is normally open at HMT (Hemmant Zone Substation) plus a tee 33kv feeder normally open at LYT (Lytton Zone Substation).

Lindum Substation was established in 1972 according to applicable design and construction standards during that time. It has an outdoor 33kV switchyard with concrete structures, and a small protection and control building.

The 33kV bus contains two bus tie circuit breakers and 6 x 33kV feeder circuit breakers. There are eight sets of manually operated 33kV bus isolators. There is a 33kV VT providing 110 V supply for protection relay functions. Existing 415V supply to the substation is provided by the outside local distribution network. For loss of distribution supply there is no alternate backup arrangements.

A schematic view of the existing sub-transmission network arrangement is shown in Figure 4 and the geographic view of Lindum Substation is illustrated in Figure 5.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

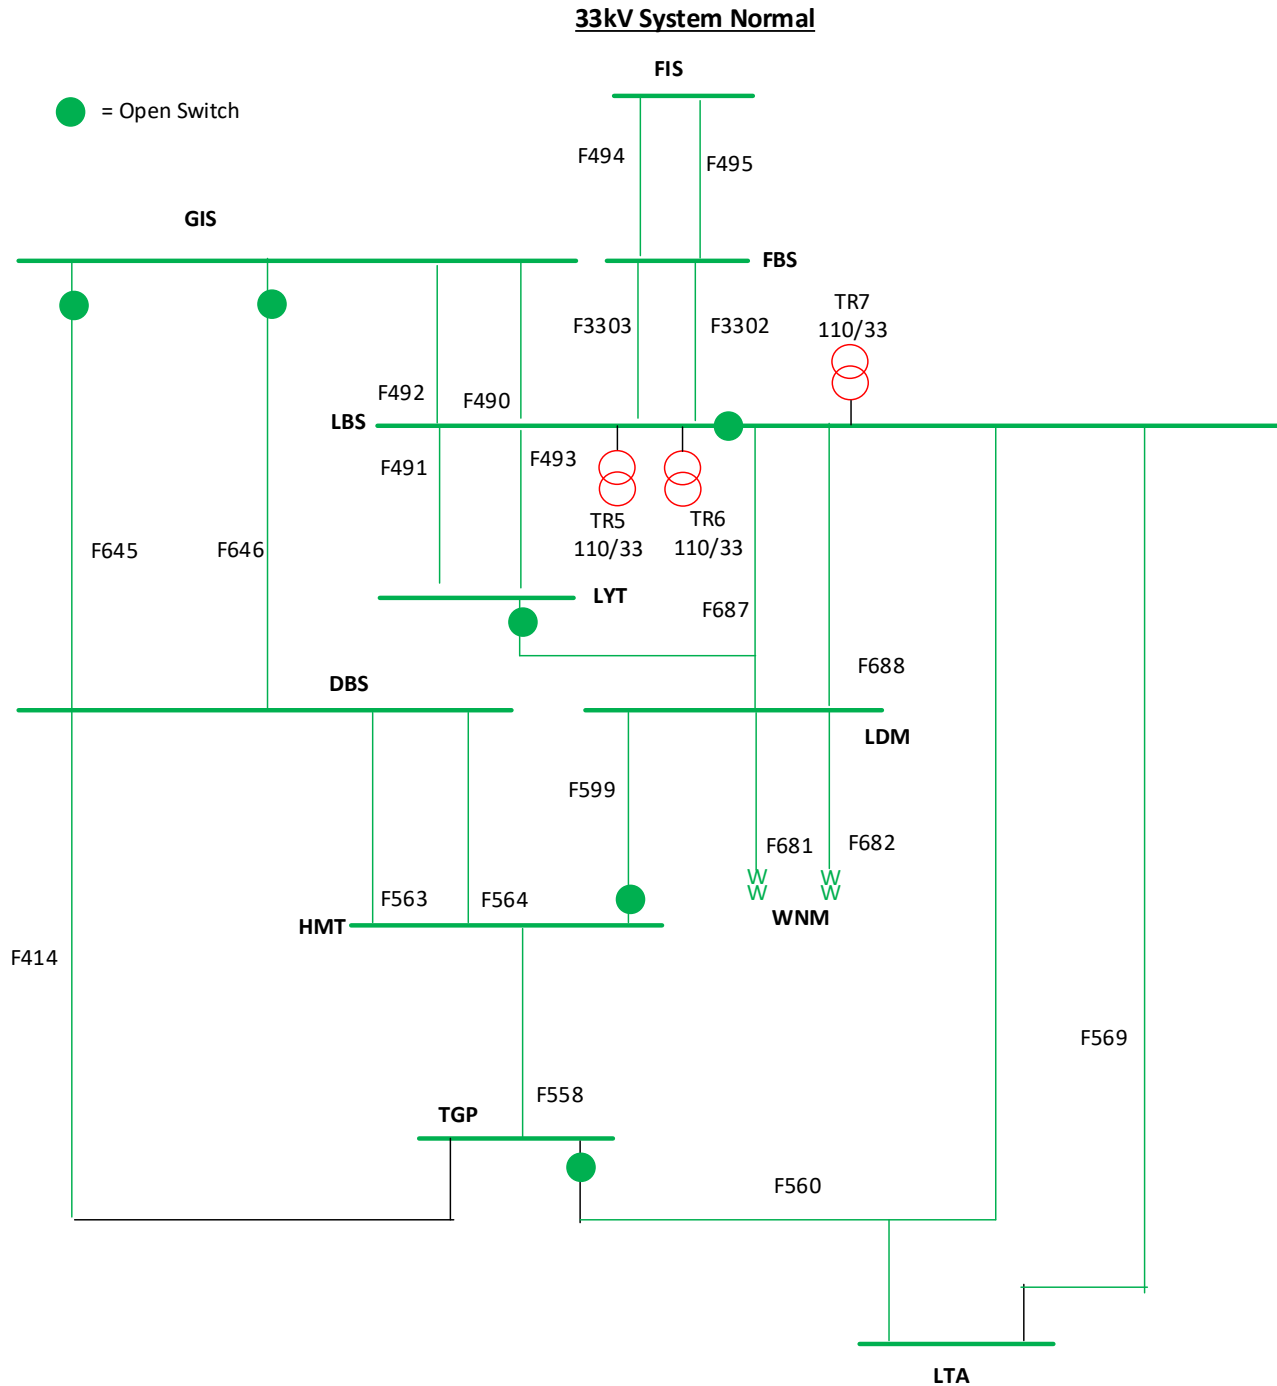


Figure 4: Existing network arrangement (schematic view)

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report



Figure 5: Lindum Substation (geographic view)

2.3. Load Profiles / Forecasts

The load at Lytton Bulk Supply Substation (110/33kV) comprises a mix of residential and commercial/industrial customers. The load is summer peaking, and the annual peak loads are predominantly driven by industrial processes.

2.3.1. Full Annual Load Profile

The full annual load profile for LBS Substation over the 2021/22 financial year is shown in **Error! Reference source not found.**6. It can be noted that the peak load occurs during summer.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

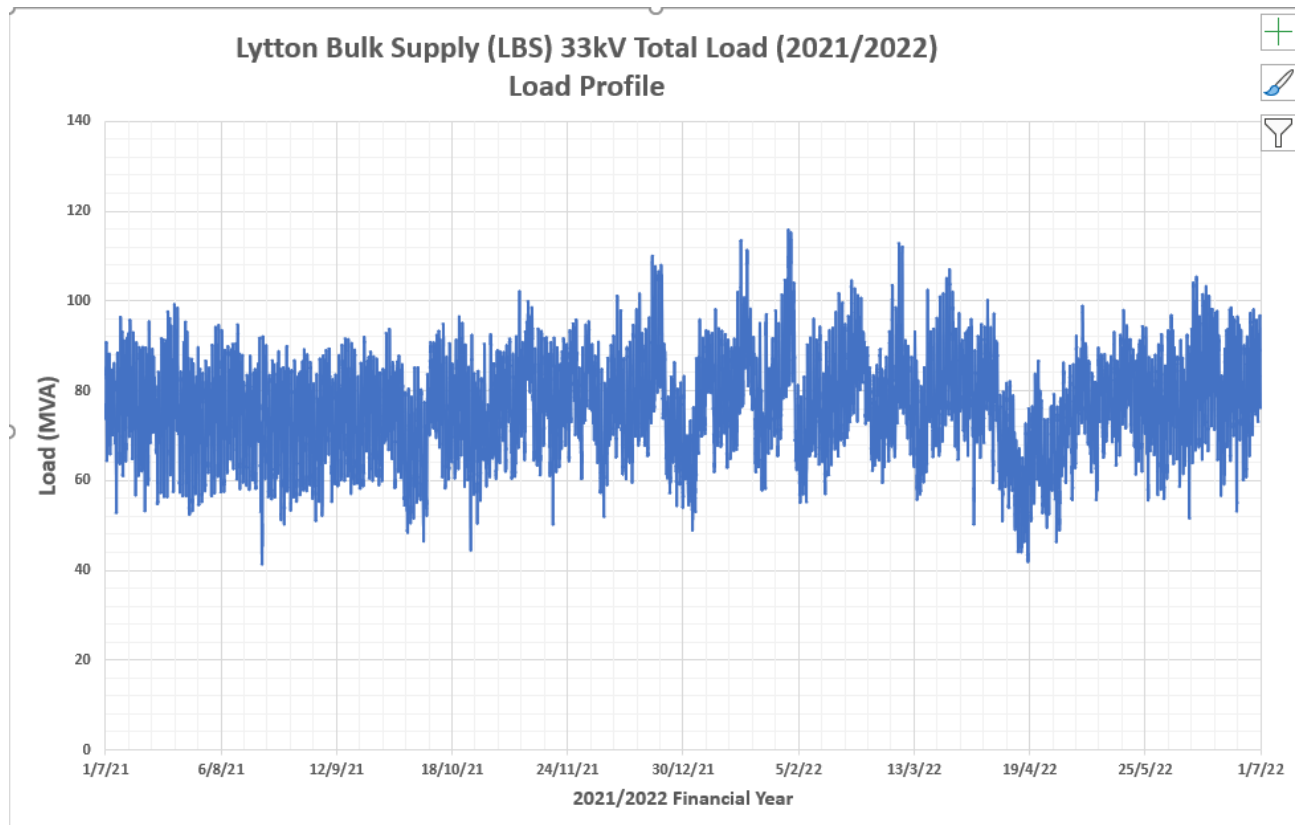


Figure 6: Substation actual annual load profile

2.3.2. Load Duration Curve

The load duration curve for LBS Substation over the 2021/22 financial year is shown in **Error! Reference source not found.**

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

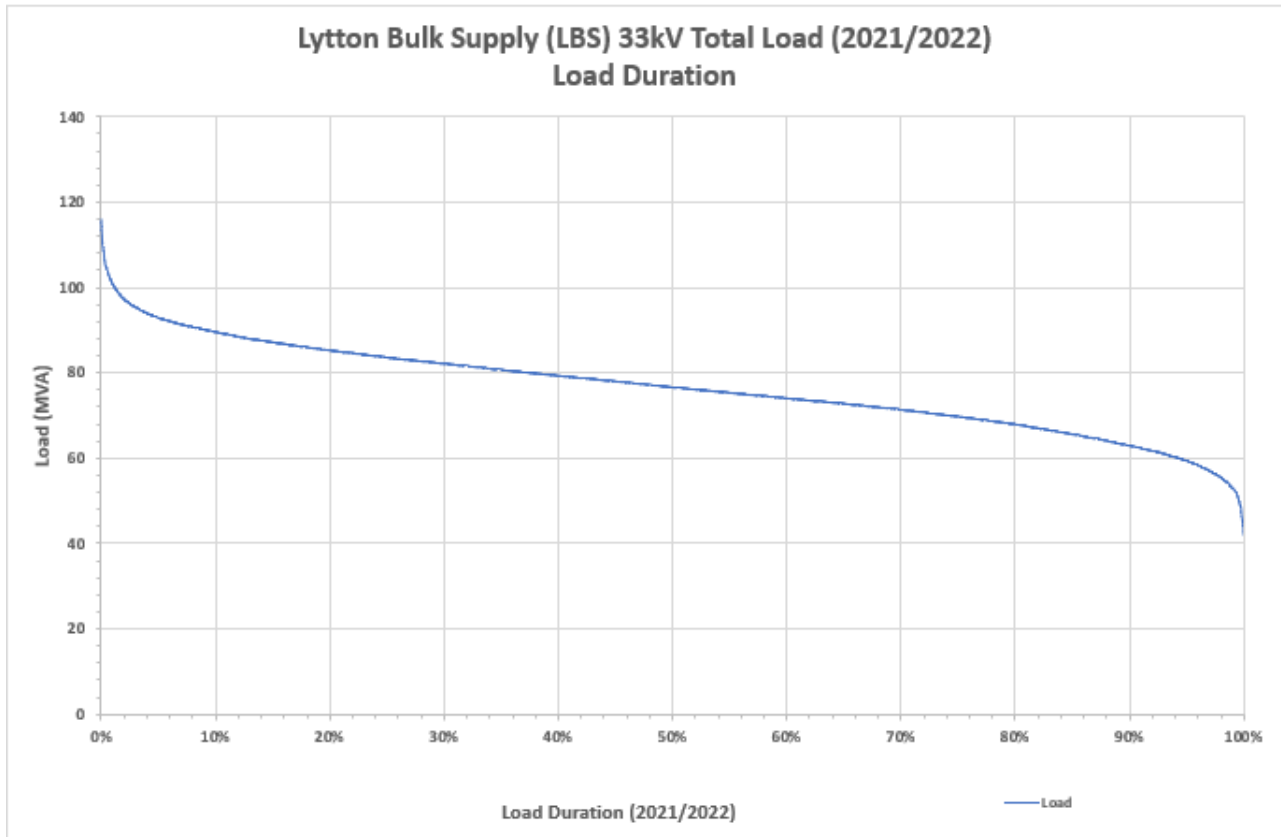


Figure 7: Substation load duration curve

2.3.3. Average Peak Weekday Load Profile (Summer)

The daily load profile for an average peak weekday during summer is illustrated below in Figure 8. It can be noted that the summer peak loads at LBS Substation are historically experienced in the late afternoon and evening.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

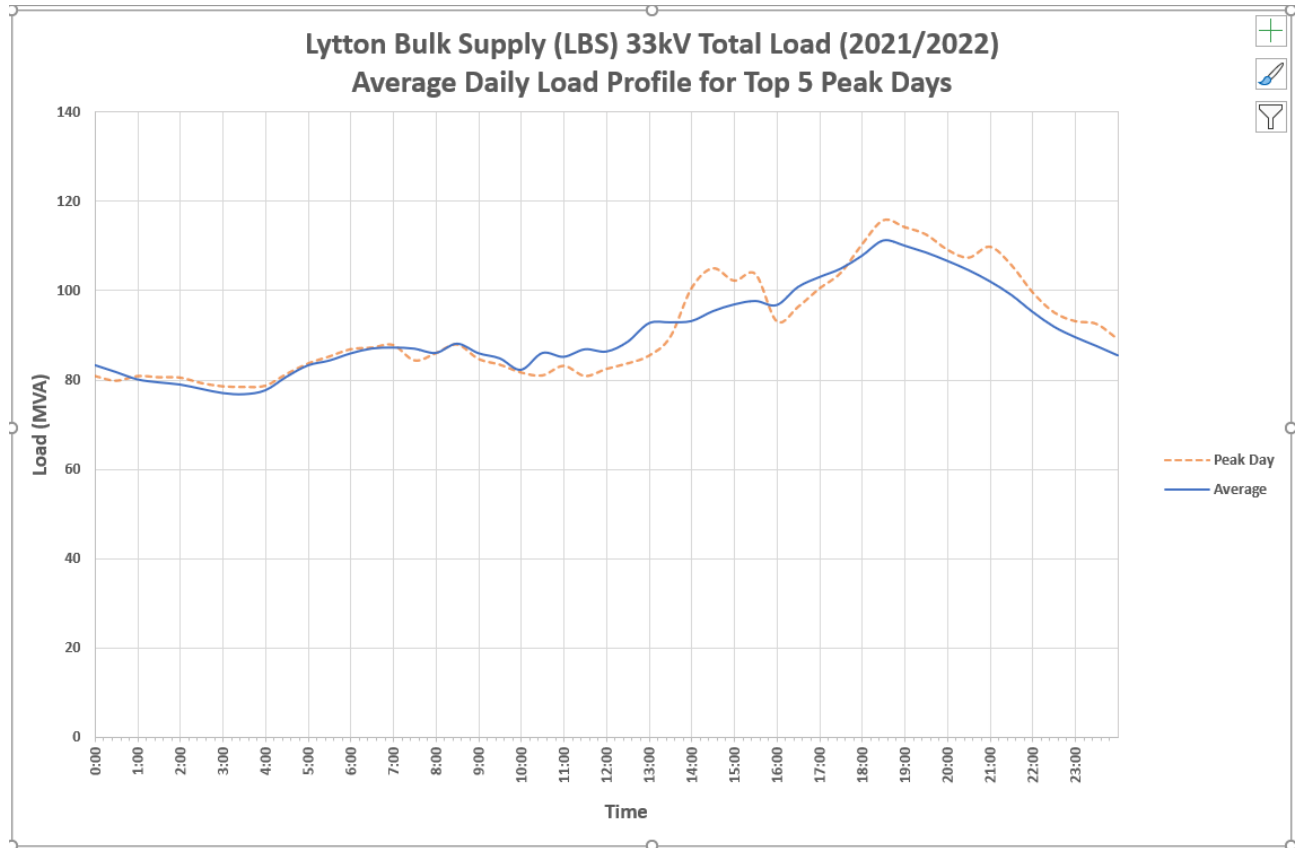


Figure 8: Substation average peak weekday load profile (summer)

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

2.3.4. Base Case Load Forecast

The 10 PoE and 50 PoE load forecasts for the base case load growth scenario are illustrated in **Error! Reference source not found.** The historical peak load for the past six years has also been included in the graph.

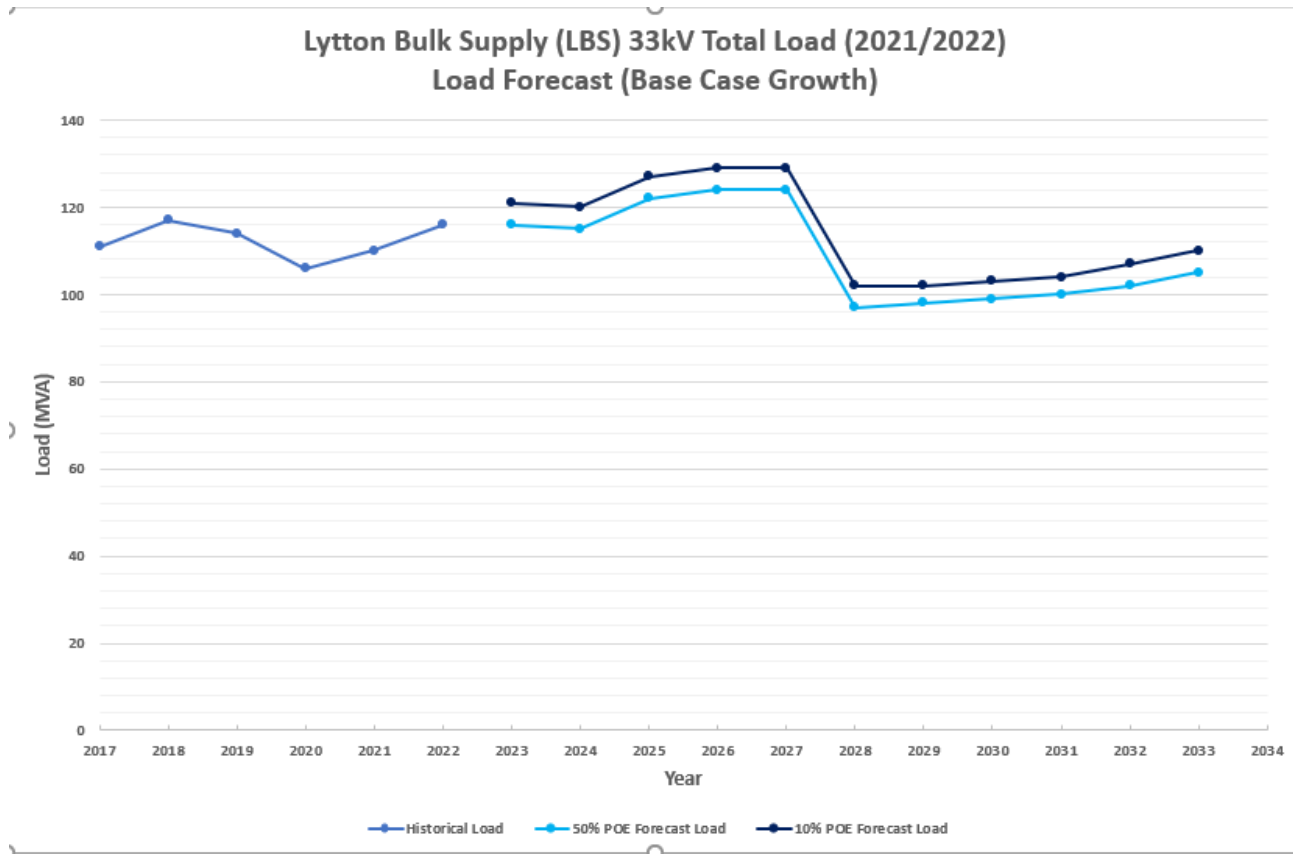


Figure 9: Substation base case load forecast

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

2.3.5. High Growth Load Forecast

The 10 PoE and 50 PoE load forecasts for the high load growth scenario are illustrated in **Error! Reference source not found.**

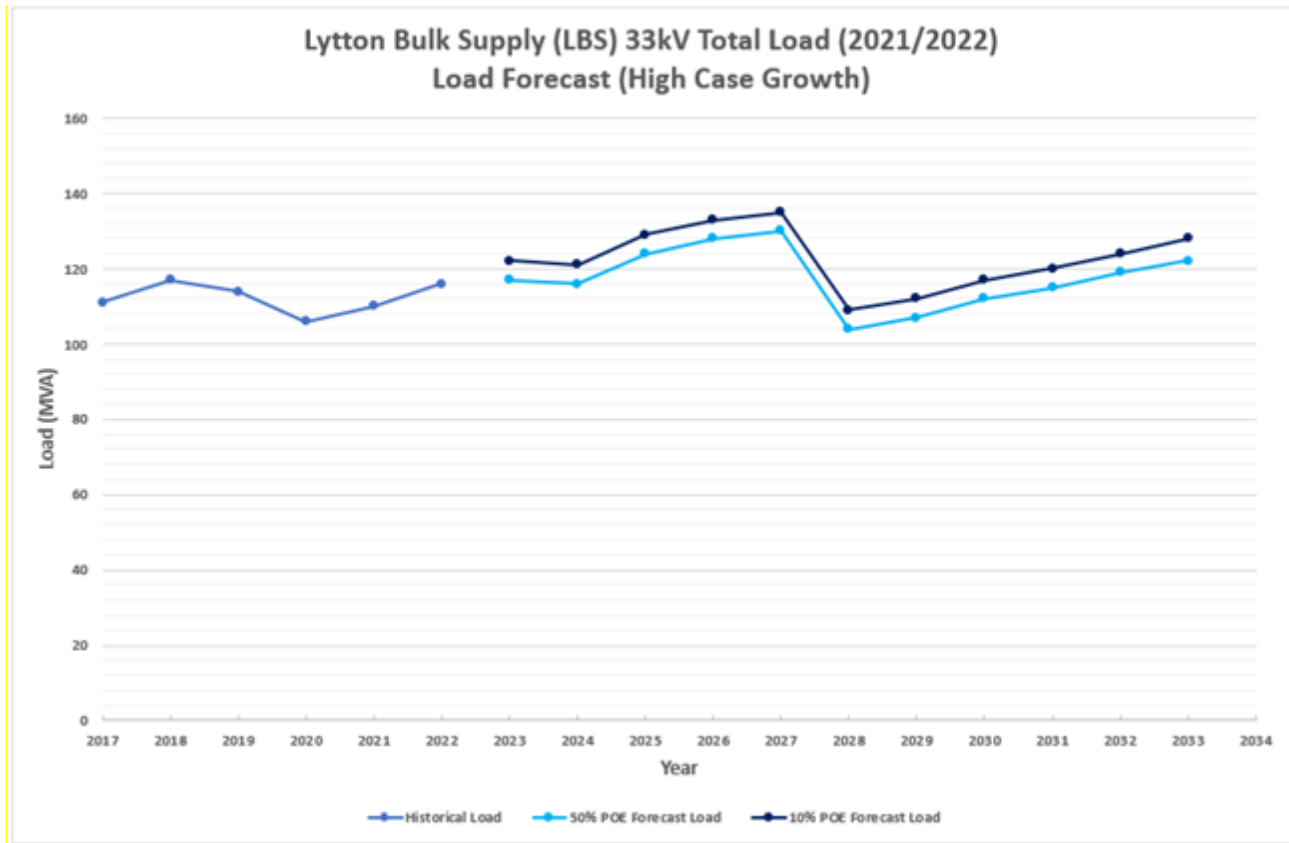


Figure 10: Substation high growth load forecast

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

2.3.6. Low Growth Load Forecast

The 10 PoE and 50 PoE load forecasts for the low load growth scenario are illustrated in **Error! Reference source not found.**

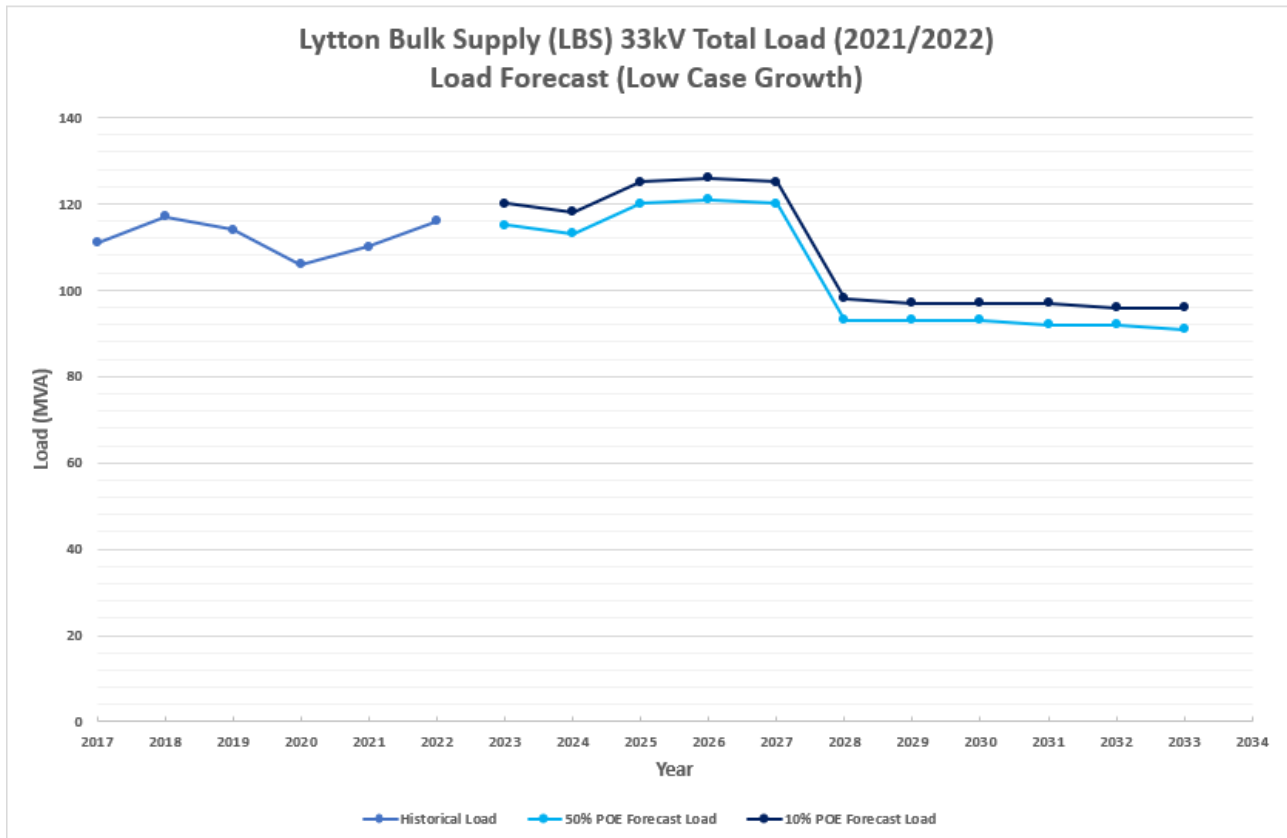


Figure 11: Substation low growth load forecast

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

3. IDENTIFIED NEED

3.1. Description of the Identified Need

3.1.1. Aged and Poor Condition Assets

A condition assessment of plant at SSLDM has highlighted that a number of critical assets are at end of life and are in poor condition. The condition of these assets presents a considerable safety, environmental and reliability risk.

Condition data indicates that the eight x 33kV outdoor oil filled circuit breakers are reaching end of life. Additionally, a civil assessment of the structures on site also identified that the substation concrete 33kV busbar support structures are deteriorating with acrow props being utilised as a temporary additional support. There are also 13 protection relays whose electronic components are nearing retirement age.

3.1.2. Reliability

There are presently on the 33kV buses at Lindum Substation. Under the existing sub-transmission network configuration any singular failure of a 33kV circuit breakers or disconnectors within Lindum Substation will result not result in an outage to customers supplied from Wynnum Substation. LDM substation is used to provide 33kV backup supply to several major customers, fed from LBS 33kV bus, therefore backup supply to Lytton Bulk Supply substation (110/33kV supply) would be restricted; particularly for a double 110kV outage to F7270 & F7271 which are on the same tower feeding LBS.

3.1.3. Safety Net Non-Compliance

Under a credible contingency event (such as for an outage of 110kV tower failure between Powerlink's H21 Murrarie Substation and Energex 110/33kV Bulk Supply Substation) benchmarked against 50% POE load, Energex will not be able to meet Safety Net restoration times without SSLDM as there are no alternate 110kV supply arrangements available for LBS Substation. 33kV supply from Energex Doboy Bulk Supply Substation, via SSLDM is the only means of restoring 33kV supply SSLBS.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

3.2. Quantification of the Identified Need

3.2.1. Aged and Poor Condition Assets

A condition assessment of plant at SSLDM has highlighted that a number of critical assets are at end of life and are in poor condition. The condition of these assets presents a considerable safety, environmental and reliability risk.

Condition data indicates that the eight x 33kV outdoor oil filled circuit breakers are reaching end of life. Additionally, a civil assessment of the structures on site also identified that the substation concrete 33kV busbar support structures are deteriorating with acrow props being utilised as a temporary additional support. There are also 13 protection relays whose electronic components are nearing retirement age.

The deterioration of these primary and secondary system assets poses safety risks to staff working within the switchyard. It also poses a safety risk the general public, though the increased likelihood of protection relay mal-operation and catastrophic failure of the oil circuit breaker or busbar support structure. There is also a considerable risk of environmental harm due to loss of oil from the oil circuit breakers, which would require clean up and rectification. Additionally, the poor condition of these assets significantly increases the likelihood of outages, resulting in a reduction in the level of reliability experienced by the customers supplied from Lindum Substation.

Where Energex identifies an imminent asset safety risk, immediate temporary measures are put in place to ensure safety of staff and public until permanent remediation can be performed.

3.2.2. Safety Net Non-Compliance

Lytton Bulk Supply Substation is a 110 / 33kV substation supplied via two 110kV feeders, located on the same tower structures, from H21 Murrarie (Powerlink Substation). There is no alternate 110kV supply available to SSLB, therefore for a double 110kV feeder outage or tower failure the only means of restoring 33kV supply to LBS is from SSDBS via SSLDM.

Zone Substations fed from LBS 33kV system are, GIS (Gibson Island), LYT (Lytton), FIS (Fishermans Island), FBS (Fishermans Island Bulk), WNM (Wynnum), LTA (Lota), LBS (Lytton Bulk Supply 11kV Network). Of these GIS and LYT are categorised as High Security Zone Substations.

Several major customers would be affected including one large customer with an energy consumption for 12 months of 150GWh and AD of 25MVA, another with energy consumption for 12 months of 48.25GWh and maximum AD of 12.5MVA, a third with energy consumption for 12 months of 108GWh and maximum AD of 19.23MVA, and the fourth with a max AD of 12MVA.

SCADA data shows that LBS supplies a total of 133 MVA of load.

There is a total of 120MVA of 33kV load transfer capacity available from SSDBS to SSLBS of which 22MVA is available via LDM.

Based on Energex's Safety Net contingency management plan for LBS the assessed time to carry out remote transfers (120MVA) is two hours with a further 12MVA of mobile generation to supplement the supply shortfall.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

3.2.3. Risk Quantification Benefit Summary

Risk quantification analysis has been completed for Option A which includes the value of customer reliability and cost of emergency replacement. Figure 12 shows the benefits of Option A in comparison to the counter-factual, which in this case is continuing the use of the existing circuit breakers, maintenance and operation until failure. The benefit of this option is primarily driven by the significant emergency replacement cost.

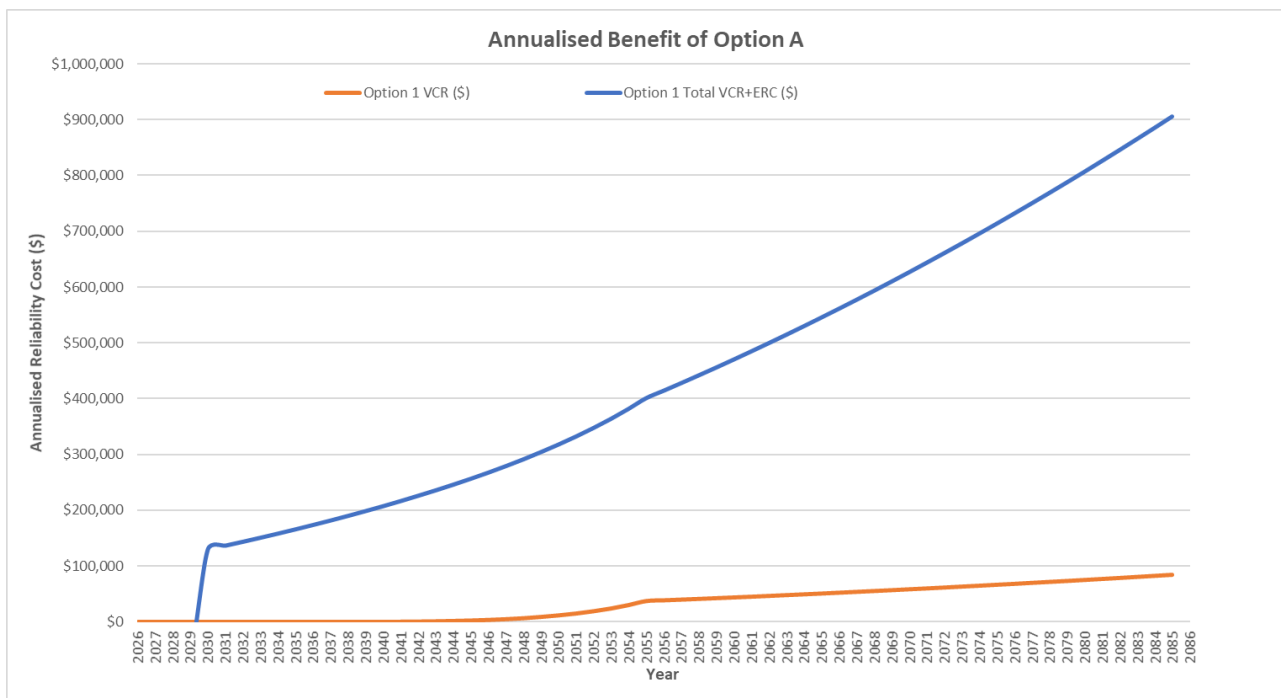


Figure 12: Annualised Benefits of Option A

3.3. Assumptions in Relation to Identified Need

Below is a summary of key assumptions that have been made when the identified need has been analysed and quantified.

It is recognised that the below assumptions may prove to have various levels of correctness, and they merely represent a 'best endeavours' approach to predict the future identified need.

3.3.1. Forecast Maximum Demand

It has been assumed that forecast peak demand at LBS Substation will be consistent with the base case forecast outlined in Section 2.3.4.

Factors that have been taken into account when the load forecast has been developed include the following:

- load history;
- known future developments (new major customers, network augmentation, etc.);
- temperature corrected start values (historical peak demands); and

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

- forecast growth rates for organic growth.

3.3.2. Load Profile

Characteristic peak day load profiles shown in Section 3.3.1 are unlikely to change significantly from year to year and the shape of the load profile is assumed to remain virtually the same with increasing maximum demand.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

4. CREDIBLE OPTIONS ASSESSED

4.1. Assessment of Network Solutions

Energex has identified one credible network option that will address the identified need.

4.1.1. Option A: Replace Outdoor CBs and Maintain SSLDM

This option involves replacing eight x outdoor 33kV oil circuit breakers with vacuum breakers, replacing all concrete 33kV ring bus structures and upgrading the substation physical security and addressing secondary systems limitations in order to address the identified need.

A schematic diagram of the proposed network arrangement for Option A is shown in Figure 13.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

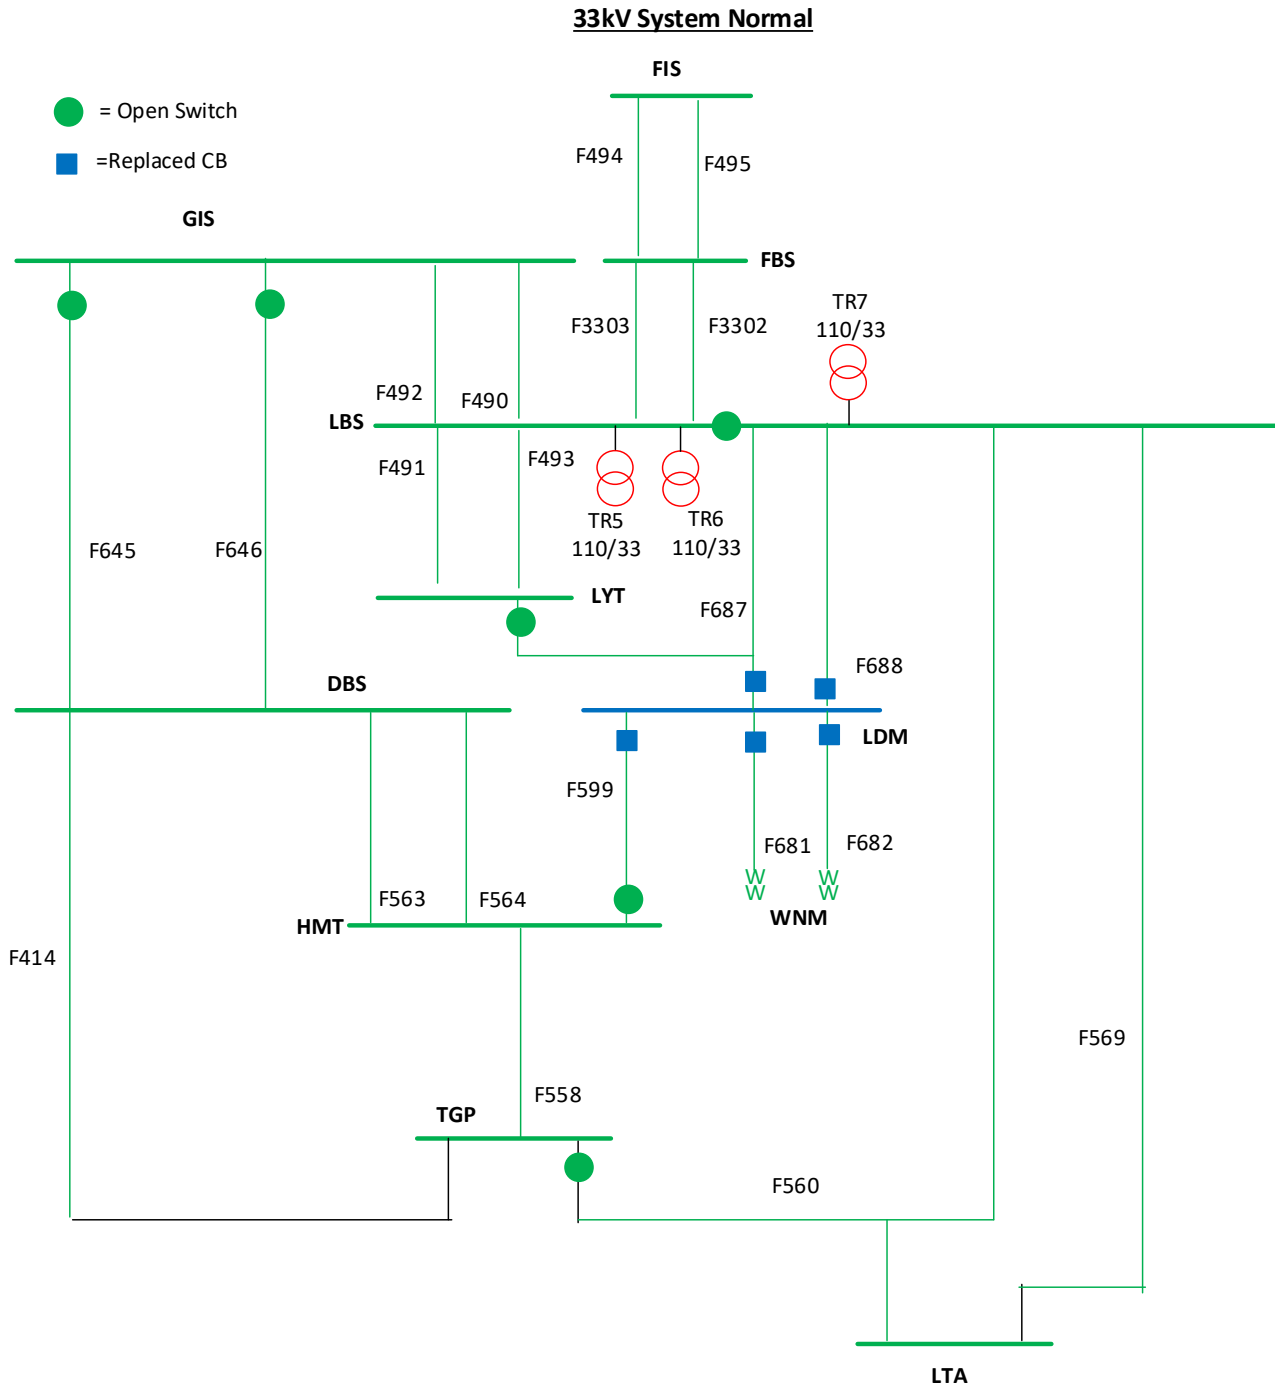


Figure 13: Option A proposed network arrangement (schematic view)

4.2. Preferred Network Option

Energex's preferred internal network option is Option A, involving replacing 8 x outdoor 33kV oil circuit breakers with vacuum breakers, replacing all concrete 33kV ring bus structures and

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

upgrading the substation physical security and addressing secondary systems limitations in order to address the identified need.

Upon completion of these works, the asset safety and reliability risks at Lindum Substation will be addressed. The preferred option will provide the greatest reliability benefit for customers, whilst also reducing expenditure on obsolete and non-compliant assets while ensuring more efficient use of design and construction resources.

The estimated capital cost of this option inclusive of interest, risk, contingencies and overheads is \$13.4 million. Annual operating and maintenance costs are anticipated to be 1.5% of the capital cost. The estimated project delivery timeframe has design commencing in mid-2024 and construction completed by September 2026.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

5. NOTICE OF NO NON-NETWORK OPTIONS

On 14 November 2022, Energex published the Notice of No Non-Network Options providing details on the identified need at Lindum substation. This report provided the technical information of the poor condition asset limitations and identified that no non-network options were viable. However, as the value of the project is >\$12m the RIT-D process requires that a DPAR be published in accordance with NER clause 5.17.4(i).

6. MARKET BENEFIT ASSESSMENT METHODOLOGY

The purpose of the RIT-D is to identify the option that maximises the present value of net market benefits to all those who produce, consume and transport electricity in the National Electricity Market (NEM).

In order to measure the increase in net market benefit, Energex has analysed the classes of market benefits required to be considered by the RIT-D.

6.1. Classes of Market Benefits not Expected to be Material

The following classes of market benefits are not considered to be material for this RIT-D, and have not been included in this RIT-D assessment:

- Changes in voluntary load curtailment
- Changes in costs to other parties
- Changes in timing of expenditure
- Changes in load transfer capability
- Changes in network losses
- Option value

6.1.1. Changes in Voluntary Load Curtailment

Because none of the credible options include any voluntary load curtailment, and because there are no customers on voluntary load curtailment agreements in the Lytton Bulk Supply area at present, any market benefits associated with changes in voluntary load curtailment have not been considered.

6.1.2. Changes in Costs to Other Parties

Energex does not anticipate that any of the credible options included in this RIT-D assessment will affect costs incurred by other parties.

6.1.3. Changes in Timing of Expenditure

None of the credible options included in this RIT-D assessment is expected to affect the timing of other distribution investments for unrelated identified needs.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

6.1.4. Changes in Load Transfer Capability

None of the credible options included in this RIT-D assessment are expected to have an impact on the load transfer capability between the zone substations in the Lytton area.

6.1.5. Changes in Network Losses

Energex does not anticipate that any of the credible options included in the RIT-D assessment will lead to any significant change in network losses.

6.1.6. Option Value

The AER's view is that option value is likely to arise where there is uncertainty regarding future outcomes, the information that is available in the future is likely to change, and the credible options considered by the RIT-D proponent are sufficiently flexible to respond to that change¹.

Energex does not consider that the identified need for the options included in this RIT-D would be affected by uncertain factors about which there may be more clarity in future.

7. DETAILED ECONOMIC ASSESSMENT

7.1. Methodology

The Regulatory Investment Test for Distribution requires Energex to identify the credible option that maximises the present value of net economic benefit to all who produce, consume and transport electricity in the National Electricity Market.

Accordingly, a base case Net Present Value (NPV) has been undertaken. A sensitivity analysis was also conducted.

Further, a Monte-Carlo analysis simulation was undertaken on the base case project timings to assess the projects sensitivity to a change in the parameters of the NPV model.

7.2. Key Variables and Assumptions

The economic assessment contains anticipated costs of providing, operating, and maintaining the options as well as expected costs of compliance and administration associated with each option.

The present value comparison summary includes all costs directly associated with constructing and providing the option. This includes the cost of land and easements currently owned or to be acquired for network augmentation.

¹ AER "Regulatory Investment Test for Distribution Application Guidelines", Section A6.
Available at: <http://www.aer.gov.au/networks-pipelines/guidelines-schemes-models-reviews/regulatory-investment-test-for-distribution-rit-d-and-application-guidelines>

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

Interest on borrowings is not included as a cost in the comparison of options as it represents a cost of project financing, and as such is accounted for in present value calculations through the discounting of the project cash flows at the regulated WACC. The interest on borrowings is included in the Total Project Cost for which approval is being sought as it represents a legitimate cost of network augmentation.

7.3. Net Present Value (NPV) Results

An overview of the initial capital cost and the base case NPV results are provided in Table 1.

Option	Option Name	Rank	Net NPV	PV of Capex (\$ real)	Net Economic Benefit (\$ real)	PV of Opex (\$ real)
A	Replace CBs and maintain SSLDM	1	-\$3, 944,000	-\$13, 456,000	\$12,589,000	-\$2,077,000

Table 1: Base case NPV ranking table

Based on the detailed economic assessment, Option A is considered to provide the optimum solution to address the forecast limitations, meet customer timeframes for connection and is therefore the recommended development option.

7.4. Selection of Preferred Option

Energex's preferred option is Option A, which involves replacing eight x outdoor 33kV oil circuit breakers with vacuum breakers, replacing all concrete 33kV ring bus structures and upgrading the substation physical security and addressing secondary systems limitations in order to address the identified need at Lindum Substation.

Upon completion of these works, the asset safety and reliability risks at Lindum Substation will be addressed. The preferred option will provide the greatest reliability benefit for customers, whilst also reducing expenditure on obsolete and non-compliant assets while ensuring more efficient use of design and construction resources.

The estimated capital cost of this option inclusive of interest, risk, contingencies and overheads is \$13.4 million. Annual operating and maintenance costs are anticipated to be 1.5% of the capital cost. The estimated project delivery timeframe has design commencing in mid-2024 and construction completed by September 2026. It should be noted that the timing of this project is a dependency for future customer related projects.

7.5. Satisfaction of RIT-D

The proposed preferred option satisfies the RIT-D.

This statement is made on the basis of the detailed analysis set out in this report. The proposed preferred option is the credible option that has the highest net economic benefit under the most likely reasonable scenarios.

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

8. SUBMISSION AND NEXT STEPS

8.1. Submissions from Solution Providers

Energex invites written submissions to address the identified need in this report from registered participants and interested parties.

Energex will not be legally bound in any way or otherwise obligated to any person who may receive this RIT-D report or to any person who may submit a proposal. At no time will Energex be liable for any costs incurred by a proponent in the assessment of this RIT-D report, any site visits, obtainment of further information from Energex or the preparation by a proponent of a proposal to address the identified need specified in this RIT-D report.

The RIT-D process is aimed at identifying a technically feasible non-network alternative to the internal option that has greater net economic benefits. However, the selection of the solution provider to implement the preferred option will be done after the conclusion of the Final Project Assessment Report (FPAR) and in accordance with Energex's standards for procurement.

Submissions in writing are due by 4pm on the **28 December 2022** and should be lodged to demandmanagement@energex.com.au

8.2. Next Steps

Following Energex's consideration of submissions received in response to this report, the preferred option, and a summary of and commentary on any submissions received will be included as part of the Final Project Assessment Report (FPAR). The FPAR represents the final stage of the consultation process in relation to the application of the RIT-D.

Energex intends to publish the FPAR no later than 3 January 2023. Energex will use its reasonable endeavours to publish the FPAR by the above date. This may however not be achievable due to changing power system conditions or other circumstances beyond the control of Energex.

At the conclusion of the consultation process, Energex intends to take steps to progress the recommended solution(s) to ensure any statutory non-compliance is addressed and undertake appropriately justified network reliability improvement(s), as necessary.

Please note that at the conclusion of the Final Project Assessment Report (FPAR), for Energex to act on a submission from a non-network proponent, Energex will need to enter into a legally binding contract with that non-network proponent for delivery of the non-network solution within a timeframe satisfactory to Energex to ensure timely completion of the project. Failure to enter into a contract within a satisfactory timeframe will result in Energex reverting to the next preferred credible option identified as part of the preferred option published in the FPAR.

Step 1	Publish Non-Network Options Report (this report) inviting non-network options from interested participants	Date Released: 11th November 2022
Step 2	Consultation period	Concluded

Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

Step 4	Release of Draft Project Assessment Report (DPAR)	Date Released: 16th November 2022
Step 5	Consultations in response to the DPAR	Minimum of 6 weeks
Step 6	Publish the Final Project Assessment Report (FPAR)	Anticipated to be released by: 3rd January 2022
Energex reserves the right to revise this timetable at any time. The revised timetable will be made available on the Energex RIT-D website.		

Energex will take all reasonable efforts to maintain the consultation schedule listed above. Due to various circumstances the schedule may change, however, up-to-date information will be available on the Energex website.

During the consultation period, Energex will review, compare and analyse all internal and external solutions. Detailed economic options analysis and comparisons of expected market benefits will be undertaken during this time. At the end of the consultation and review process Energex will publish a final report which will detail the most feasible option and proceed to implement that option.

9. COMPLIANCE STATEMENT

This Draft Project Assessment Report complies with the requirements of NER section 5.17.4(j) as demonstrated below:

Requirement	Report Section
(1) a description of the identified need for investment;	3
(2) the assumptions used in identifying the identified need (including, in the case of proposed reliability corrective action, why the RIT-D proponent considers reliability corrective action is necessary;	3.3
(3) if applicable, a summary of, and commentary on, the submissions received on the NNOR;	5
(4) a description of each credible option assessed	4 & 7
(5) where a <i>Distribution Network Service Provider</i> has quantified market benefits in accordance with clause 5.17.1(d), a quantification of each applicable market benefit of each credible option	3
(6) a quantification of each applicable cost for each credible option, including a breakdown of operating and capital expenditure	6 & 7
(7) a detailed description of the methodologies used in quantifying each class of costs or market benefit	6
(8) where relevant, the reasons why the RIT-D proponent has determined that a class or classes of market benefits or costs do not apply to a credible option	6


Addressing Reliability Requirements in the LDM Network Area Draft Project Assessment Report

(9) the results of a NPV analysis of each credible option and accompanying explanatory statements regarding the results	7.3
(10) the identification of the proposed preferred option	7.4
(11) for the proposed preferred option, the RIT-D proponent must provide: (i) details of the technical characteristics; (ii) the estimated construction timetable and commissioning date (where relevant); (iii) the indicative capital and operating costs (where relevant); (iv) a statement and accompanying analysis that the proposed preferred option satisfied the RIT-D; and (v) if the proposed preferred option is for reliability corrective action and that option has a proponent, the name of the proponent	7.5
(12) contact details for a suitably qualified staff member of the RIT-D proponent to whom queries on the draft report may be directed.	1.2

Addressing Reliability Requirements in the LDM Network Area

Draft Project Assessment Report

APPENDIX A – THE RIT-D PROCESS

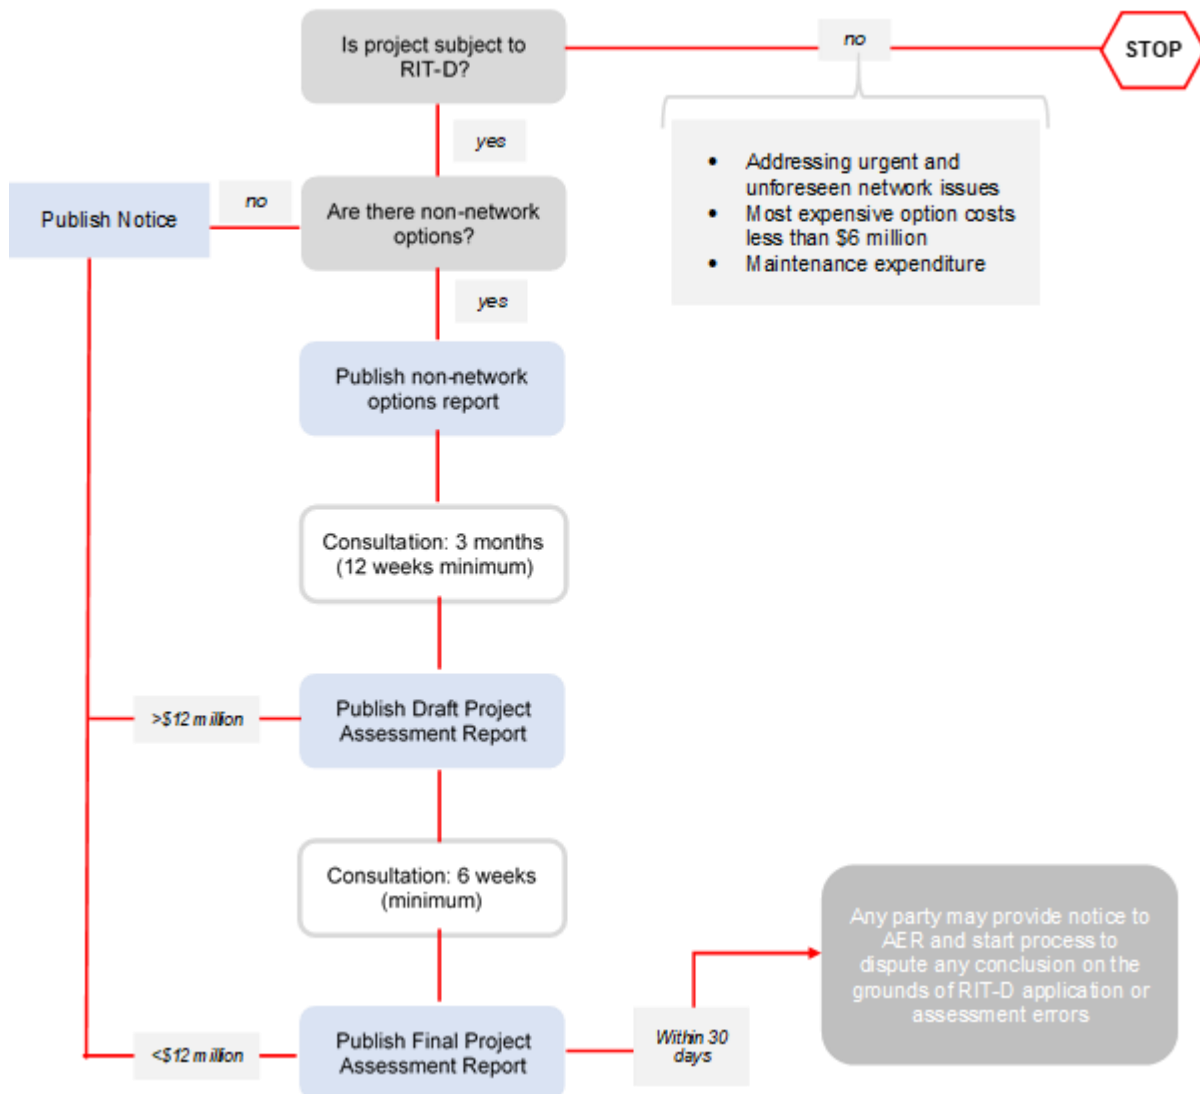

Source: AEMC, *Rule determination: National Electricity Amendment (Replacement expenditure planning arrangements) Rule 2017*, July 2017, p. 64.